

Fundamental Research on SF₆-free Gas Insulated Switchgear Adopting CO₂ Gas and Its Mixtures

Toshiyuki Uchii¹, Yoshikazu Hoshina¹, Hiromichi Kawano¹
Katsumi Suzuki¹, Tetsuya Nakamoto¹ and Mitsuru Toyoda²

1. Power and Industrial Systems R&D Center, Toshiba Corporation, Kawasaki, Japan
2. Hamakawasaki Operations, Toshiba Corporation, Kawasaki, Japan

Abstract: Fundamental properties of CO₂ gas and its mixtures as an arc quenching and insulating medium for a high-voltage power equipment were investigated theoretically and experimentally. It was noted that “self-blast” technique utilizing arc energy effectively to enhance puffer pressure is a good solution for a CO₂-applied gas circuit breaker (CO₂-GCB) because of its relatively small heat capacity and high arc voltage. A 72 kV-31.5 kA class CO₂-GCB model was designed, produced, and it showed satisfactory performance for major test-duties. In addition, a life cycle assessment (LCA) was carried out to evaluate the environmental contribution by applying CO₂ gas as an alternative medium. An LCA calculation based on the developed CO₂-GCB model reveals that it could reduce the global warming impact compared to the latest SF₆ gas circuit breaker in the considered life cycle scenario. Furthermore, CO₂-based environmentally-benign gas mixtures, such as CO₂/O₂, were also investigated. Some kinds of additional gases might increase arc-quenching and/or insulating performance compared to that of pure CO₂ gas.

Keywords: SF₆ gas, CO₂ gas, mixture, gas insulated switchgear(GIS), gas circuit breaker(GCB), global warming

1. INTRODUCTION

SF₆ gas has widely been used for a high-voltage electric power equipment such as a gas insulated switchgear (GIS) and a gas circuit breaker (GCB) due to its excellent insulating and arc-quenching capability. Although SF₆ gas strongly contributes to achieve compactness and high reliability of the equipment, it has been recognized as one of the potent global warming gases and was designated to reduce the emissions at COP3 in Kyoto in 1997. At present, strategic effort to reduce the emissions is being made, which actually proves effective.[1] Over the long term, however, it is certainly preferable to reduce the consumption itself, because its atmospheric life time is observed to be quite long, thus the amount of SF₆ gas on the earth will inevitably get increasing in the future unless artificial destruction.

With the above background, the authors focus on CO₂ gas as an alternative medium of SF₆ gas, which has very low global warming potential compared to SF₆ gas (1/23,900). Fundamental properties of CO₂ gas as an arc-quenching and insulating medium were investigated theoretically and experimentally. Based on these findings, a 72 kV-31.5 kA class CO₂ gas circuit breaker (hereinafter called CO₂-GCB) model was designed, produced, and tested. As a result of current interruption and dielectric insulation tests, the CO₂-GCB model achieved practical levels of performance for major test-duties.

In addition, a life cycle assessment (LCA) was carried out to evaluate the environmental contribution by applying CO₂ gas as an alternative medium. An LCA calculation based on the developed CO₂-GCB model reveals that it could reduce the global warming impact by about 45% compared to the latest SF₆ gas circuit breaker in the considered life cycle scenario.

Furthermore, the authors also investigated some

CO₂-based environmentally-benign gas mixtures such as CO₂/O₂. These additional gas(es) might increase arc-quenching and/or insulating performance compared to that of pure CO₂ gas. In the present paper, some experimental results will be briefly introduced.

2. WHY CO₂ GAS?

The gases that are applicable to an environmentally-benign electric power equipment are required to have no or minimal toxicity, global warming effect and ozone depletion effect, and should remain gaseous at low temperatures, for example, around -30 °C. When selecting the alternative gases widely from the above viewpoints, the possible candidates are narrowed down to air, N₂, O₂, H₂, CO₂, rare gases (He, Ar, etc), and their mixtures.[2] In practice, they are also required to have adequate insulating and arc-quenching capability, chemical stability, and have no flammability and explosiveness. Eventually, the possible candidates that can be applied as single gas or main gas of mixture could be limited only to N₂ and CO₂. (Here, air is regarded as an N₂-based mixture.) Although CO₂ is recognized as one of the representative global warming gases, it can be considered applicable as far as power equipment application because the gas amount for this use is negligible little compared with the globally concerned amount.[3]

Table 1 shows the comparison of fundamental gas properties of SF₆, CO₂ and N₂. As shown in Table 1, CO₂ meets the basic requirements for application to an environmentally-benign electric power equipment. In addition, CO₂ has a lower boiling temperature than SF₆, and it is known that CO₂ remains gaseous at low temperature ranges down to -40 °C even at a high gas pressure of 1.0 MPa-abs.

Table 1. Comparison of fundamental gas properties between SF₆, CO₂ and N₂.

Gas	SF ₆	CO ₂	N ₂
Molecular mass	146.06	44.01	28.01
Density (kg/m ³) ^{*1}	5.9	1.8	1.1
GWP ^{*2}	23,900	1	~0
ODP ^{*3}	–	–	–
Toxicity ^{*4}	–	–	–
Chemical stability	Stable	Stable	Stable
Flammability / Explosibility	–	–	–
Boiling temperature (°C) ^{*5}	–51	–78	–198
Dielectric strength (%) ^{*6}	100 (–)	34 (–)	25 (+)
Arcing time constant (μs) ^{*7}	0.8	15	220

^{*1} At 300 K, 1 atm

^{*2} Global Warming Potential, Integrated period 100 years (IPCC, 1995)

^{*3} Ozone Depletion Potential

^{*4} As pure gas (Note that arced gas could be different)

^{*5} At 1 atm

^{*6} 50% breakdown voltage measured by a full-scale coaxial cylindrical electrode[4](The weak polarity value is shown), Lightning impulse, At 0.9 MPa-abs

^{*7} Measured for a free-burning arc at 1 atm

As for insulating capability, as also shown in Table 1, CO₂ is naturally lower than SF₆, but its 50% breakdown voltage is about 35% higher than that of N₂ at a high gas pressure of 0.9 MPa-abs.[4]

In Table 1, arc-quenching capability is evaluated by arcing time constant as an index for thermally interrupting capability of a gas. Qualitatively, smaller arcing time constant suggests better thermal interrupting capability. Table 1 shows that the arcing time constant of CO₂ is higher than that of SF₆, but is below one tenth of that of N₂.

In short, although CO₂ gas is inferior to SF₆ gas in insulating and arc-quenching capabilities, it surpasses N₂ gas which is regarded as a representative alternative gas in many previous works, particularly in arc-quenching capability. This suggests that CO₂ gas is a promising alternative gas, particularly for switching apparatus such as a GCB.

3. CO₂ GAS AS AN ALTERNATIVE MEDIUM FOR A CIRCUIT BREAKER

3.1. Basic features

Arc-quenching capability of a gas itself can be estimated to some extent from the arc time constant shown in Table 1. Specifically, arc-quenching capability of CO₂ gas is considered between SF₆ gas and N₂ gas. As known generally, the higher blasting pressure toward arc around a current zero leads the higher thermal interruption performance. This means, higher blasting pressure is necessary for CO₂ gas to interrupt the same current in the same condition compared to SF₆ gas.

On the other hand, a puffer-blast-type GCB widely disseminated nowadays must be designed so that puffer pressure keeps necessary level for a successful interruption around a current zero for every required arcing time condition. Thus, as far as considering a puffer-blast-type GCB, puffer pressure build-up characteristic during a

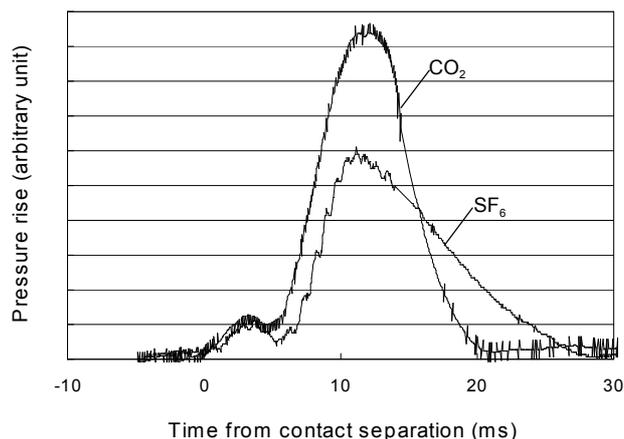


Fig. 1. Difference of puffer pressure properties between SF₆ gas and CO₂ gas during a current interruption. (Measured in 28.4 kA interruption)

current interruption process is a fundamental factor, as well as the arc-quenching properties of the gas itself.

Fig. 1 shows puffer pressure waveforms during a current interruption for both CO₂ gas and SF₆ gas obtained with the same current condition and the same puffer-type interrupter. As seen obviously in Fig. 1, the puffer pressure of CO₂ gas rises up rapidly to higher level compared to SF₆ gas. This is due to small heat capacity ρC_V (where ρ , C_V represent density, specific heat at constant volume, respectively) and higher arc voltage (i.e. larger energy input to the arc) of CO₂ gas, which is basically preferable property especially for a short arcing time condition. On the other hand, Fig. 1 also indicates puffer pressure of CO₂ gas decreases faster compared to SF₆ gas. This is mainly due to higher sound velocity of CO₂ gas, which causes faster pressure leakage from the puffer cylinder. This fact implies inferior interruption performance in a long arcing time condition. To maintain high levels of puffer pressure even in a long arcing time condition, it can be considered that larger puffer cylinder volume would be necessary when adopting CO₂ gas. Consequently, for a puffer-type interrupter using CO₂ gas, both larger puffer cylinder volume and higher puffer pressure rise are conflictly necessary, which leads larger driving energy, size, higher cost, and so on.

To avoid these as well as possible, puffer-type interrupter with “self-blast” technique could be a good solution. “Self-blast” means puffer-pressure enhancing technique by utilizing arc energy effectively. Self-blast technique is known to be effective for SF₆ gas, but it can be considered more effective for CO₂ gas, because of its smaller heat capacity and higher arc voltage, which enables to get higher pressure more easily by self-blast process.

The authors focus on Hybrid-puffer™ technique, one of the self-blast-type interrupters.[5] Fig. 2 shows the analytical result of the puffer pressure rise at current zero, compared between a conventional double-flow-type and Hybrid-puffer™-type interrupters for both CO₂ and SF₆. As noted in Fig. 2, Hybrid-puffer™ brings about higher puffer pressure rise at current zero throughout the considered arcing time condition for both SF₆ gas and CO₂

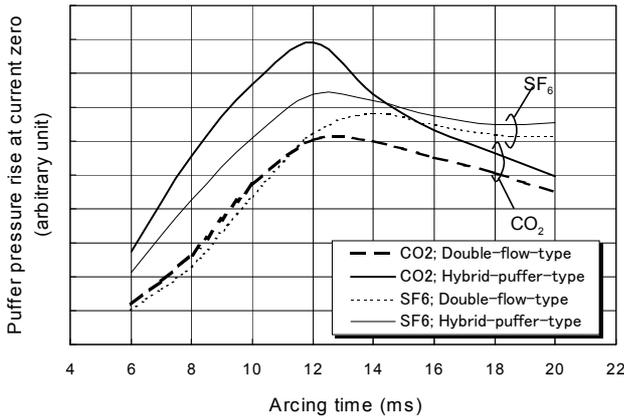


Fig. 2. Comparison of puffer pressure enhancing effect by Hybrid-puffer™ technique between SF₆ and CO₂.

gas, but it can be seen more apparently for CO₂ gas case, which suggests Hybrid-puffer™ technique is more effective for CO₂ than SF₆ as expected.

3.2. Development of 72 kV-31.5 kA CO₂-GCB model

Based on the basic investigations of CO₂ properties, a 72 kV-31.5 kA class CO₂-GCB model, shown in Fig. 3, was designed and produced. The specifications of the model are shown in Table 2. The filling gas pressure is 0.8 MPa-abs, which is a little higher than that of a usual SF₆-GCB. In practical use of a CO₂-GCB, however, the filling gas pressure could be higher, for example 1.0MPa-abs, in consideration of gas liquefaction, safety, and related regulations. In the CO₂-GCB model, a Hybrid-puffer™-type interrupter specially designed for CO₂ gas was adopted. Furthermore, all the dimensions of the GCB components were determined based on fundamental dielectric data of CO₂ gas with sufficient margin. The tank diameter is about 1.7 times as large as that of the latest SF₆-GCB in the same rating.

Current interruption and insulation tests of the CO₂-GCB model were carried out based on the standard of IEC 62271-100. The test results are summarized in Table 3. As shown in Table 3, the CO₂-GCB model achieved satisfactory performance for major test-duties; namely, capacitive current switching, short-line fault 90%, terminal current switching, short-line fault 90%, terminal current switching, power-frequency and lightning impulse insulation.

Decomposed products and gases after current interruptions are also one of the fundamental issues from the practical viewpoint. It was observed that no harmful arced gas which cannot be absorbed by Zeolite and that no controversial decomposed product for the practical use were detected even after more than 10 times large current interruptions.[3]

4. ENVIRONMENTAL IMPACT ESTIMATION BY A LIFE CYCLE ASSESSMENT

Life cycle assessment (LCA) is known as a means evaluating environmental burdens quantitatively in the “cradle-to-grave” life cycle of a product. An LCA study was carried out to evaluate the environmental contribution of the CO₂-GCB model shown in Fig. 3.



Fig. 3. View of the 72 kV-class CO₂-GCB model (for single phase).

Table 2. Specifications of the CO₂-GCB model.

Items	Value
Filling gas	CO ₂ 100%
Filling gas pressure	0.8 MPa-abs
Rated voltage	72 kV
Rated interrupting current	31.5 kA
Power frequency	50 Hz
Rated ACWV	140 kV _{rms}
Rated LIWV	350 kV

Table 3. Summary of the test results of the CO₂-GCB model. (O: Success, X: Failure)

RATINGS	72.5 kV-31.5kA-50Hz	
STANDARD	IEC 62271-100	
DUTY	RESULT	JUDGEMENT
Capacitive current switching (After 3 times 60% current interruptions)	NO Restrike during 16 times interruptions around the minimum arcing time with the recovery voltage of 1.7 x 72.5kV/1.73.	Satisfactory
Short line fault 90% (L90)	Arcing time: 	Interruption window: 9.5 ms secured Satisfactory
Breaker terminal fault 100%, Symmetrical (T100s(b))	Arcing time: 	Interruption window: 3.3 ms for first-pole-clearing, 8.2 ms secured over all. Satisfactory
Breaker terminal fault 100%, Asymmetrical (T100a) (Major loop)	Arcing time: 	Interruption window*: 3.6 ms for first-pole-clearing, 8.0 ms secured over all. Satisfactory
LI insulation	375 kV No F.O.	Satisfactory
AC insulation	160 kV _{rms} No F.O.	Satisfactory

*Minimum arcing time for minor loop is assumed from T100s

Fig. 4 shows the considered life cycle flow and the conditions of the LCA, and the result is shown in Fig. 5. It was noted from Fig. 5 that the contribution due to materials is larger for the CO₂-GCB than the SF₆-GCB, but contribution due to gas leakage is extremely low for the

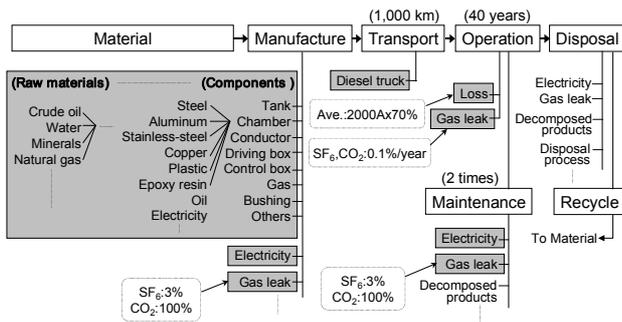


Fig. 4. Considered life cycle flow and conditions of the LCA.

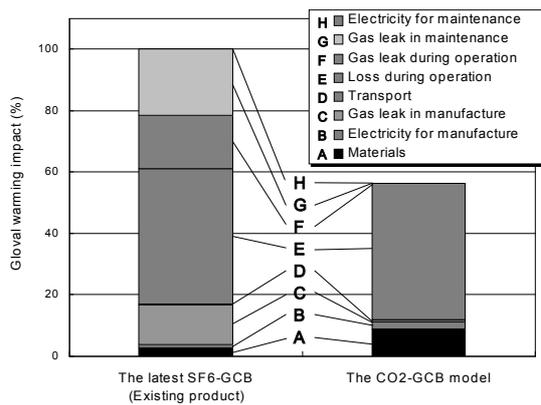


Fig. 5. Reduction of global warming impact during 40 years operation by the CO₂-GCB model.

CO₂-GCB. As a whole, the CO₂-GCB model could reduce the global warming impact by about 45% compared to the latest SF₆-GCB in the same rating for 40 years operation including two maintenance opportunities.

5. POSSIBILITY OF CO₂-BASED GAS MIXTURES

One of the strategies to improve performance of a CO₂-applied switchgear may include admixture of appropriate gas(es) to CO₂ gas. Needless to say, that additional gas must be environmentally-benign one, which is apparently a kind of natural origin gases as described in chapter 2. Adding extra gas(es), arc-quenching and dielectric properties of the gas naturally change, and it is expected in some cases that the current interruption and/or the insulation capabilities could improve.[6,7] The authors focus on CO₂/O₂ gas mixture here as one example, and introduce some experimental findings below.

The arcing time constant of O₂ gas is known to be relatively small, specifically 1.5 μs whereas 0.8 μs for SF₆ gas, 15 μs for CO₂ gas, 220 μs for N₂ gas for a free-burning arc.[8] This fact implies O₂ gas would have preferable arc-quenching capability than CO₂ gas. Pure O₂ gas, however, could not be applied as an alternative gas, because of its supportive flammability and strong corrosivity. The authors, therefore, adopted CO₂(85%)/O₂(15%) gas mixture, and gave it a trial in a short-line fault 90% interruption with a current of 28.4 kA (90% of 31.5 kA) and a surge impedance of 450 Ω by using the CO₂-GCB model shown in Fig. 3. Both pure

CO₂ gas and CO₂/O₂ gas mixture cases succeeded in interruption, but the post arc current of the two gases were obviously deferent, showing much smaller in the case of CO₂/O₂ gas mixture. In other words, admixture of 15% O₂ gas causes reduction of post arc current, which implies that adding O₂ gas could make decaying rate of arc conductivity faster.

Another remark is concerned with decomposed product generated by arcing. In a large current interruption with pure CO₂ gas, brownish powder product was generated, and it was proved from elemental analysis by an X-ray micro analyzer(EDX) that the powder contained free carbon although it seemed very slight. When mixing 15% O₂ gas, on the other hand, decomposed product changed whitish, and no carbon peak was detected. This result suggests that O₂-rich atmosphere seems to reduce free carbon generation that might deteriorate dielectric reliability.

Dielectric properties of CO₂/O₂ gas mixture were also investigated. The 50% lightning impulse breakdown voltages of pure CO₂ gas and CO₂(80%)/O₂(20%) gas mixture were obtained by up-down method at 1.1 MPa-abs with coaxial cylinder electrode system with a conductor diameter of φ120 mm and a tank diameter of φ300 mm. As a result, admixture of 20% O₂ gas brings about 17% increase of breakdown voltage compared to pure CO₂ gas.

6. CONCLUSIONS

The authors focus on CO₂ gas as an alternative medium of SF₆ gas, which has very low global warming potential compared to SF₆ gas (1/23,900). Fundamental properties of CO₂ gas and its mixtures as an arc quenching and insulating medium were investigated theoretically and experimentally. The conclusions are listed below:

- 1) It was found that “self-blast” technique utilizing arc energy effectively to enhance puffer pressure is a good solution for a CO₂-GCB because of its relatively small heat capacity and high arc voltage. A 72 kV-31.5 kA class CO₂-GCB model, which does not contain SF₆ gas at all, was designed, produced, and tested. In this model, a Hybrid-puffer™ interrupter specially designed for CO₂ gas was adopted. The tank diameter is about 1.7 times as large as that of the latest SF₆-GCB in the same rating. As a result of current interruption and dielectric insulation tests, the CO₂-GCB model showed satisfactory performance for major test-duties.
- 2) A life cycle assessment (LCA) was carried out to evaluate the environmental contribution by applying CO₂ gas as an alternative medium. An LCA calculation based on the developed CO₂-GCB model reveals that it could reduce the global warming impact by about 45% compared to the latest SF₆ gas circuit breaker in the considered life cycle scenario.
- 3) Admixture of appropriate gas(es) to CO₂ gas might increase arc-quenching and/or insulating performance compared to pure CO₂ gas. CO₂/O₂ gas mixture was adopted as one example, and it was noted that admixture of O₂ gas caused reduction of post arc current in the short-line fault interruption, and also increase of lightning impulse breakdown voltage com-

pared to pure CO₂ gas.

REFERENCES

1. U. S. Environmental Protection Agency, International Conference on SF₆ and the Environment: Emission Reduction Strategies, San Diego, URL: <http://www.epa.gov/highwp1/sf6/> (2002).
2. Toshiba Corporation, "Development of Dielectric and Arc-quenching Gases and Their Applications to Power Equipment for Mitigating Global Warming", Final R&D Report for FY 2001 Proposal-Basic R&D Program of New Energy and Industrial Technology Development Organization(NEDO), pp. 3-8 (2001) (in Japanese)
3. T. Uchii et al., "Development of 72 kV-Class Environmentally-benign CO₂ Gas Circuit Breaker Model", IEE of Japan Trans. PE, Vol. 124, No. 3, pp. 476-484 (2004) (in Japanese)
4. Y. Hoshina, et al., "Lightning Impulse Breakdown Characteristics of SF₆ Alternative Gases for Gas-insulated Switchgear", IEE Proc. Sci. Meas. Technol., Vol. 153, No. 1, pp. 1-6 (2006)
5. S. Yanabu et al., "Development of Novel Hybrid Puffer Interrupting Chamber for SF₆ Gas Circuit Breaker Utilizing Self-Pressure-Rise Phenomena by Arc", IEEE Trans. on Power Delivery, Vol. 4, No. 1, pp. 355-361 (1989).
6. M. Sato et al., "Variation in arc interruption performance due to admixture of N₂ to CO₂", Proc. of Tokai-Section Joint Conferences of Electrical and Related Engineers (2007) (in Japanese)
7. N. Hayakawa et al., "Synergy Effect in Electrical Insulation Characteristics of N₂O Gas Mixture", IEE of Japan Trans. PE, Vol. 126, No. 11, pp. 1164-1170 (2006) (in Japanese)
8. K. H. Yoon et al., "A Study of the Dynamic Response of Arcs in Various Gases", AIEE, Vol. 77, pp. 1634-1642 (1959)